
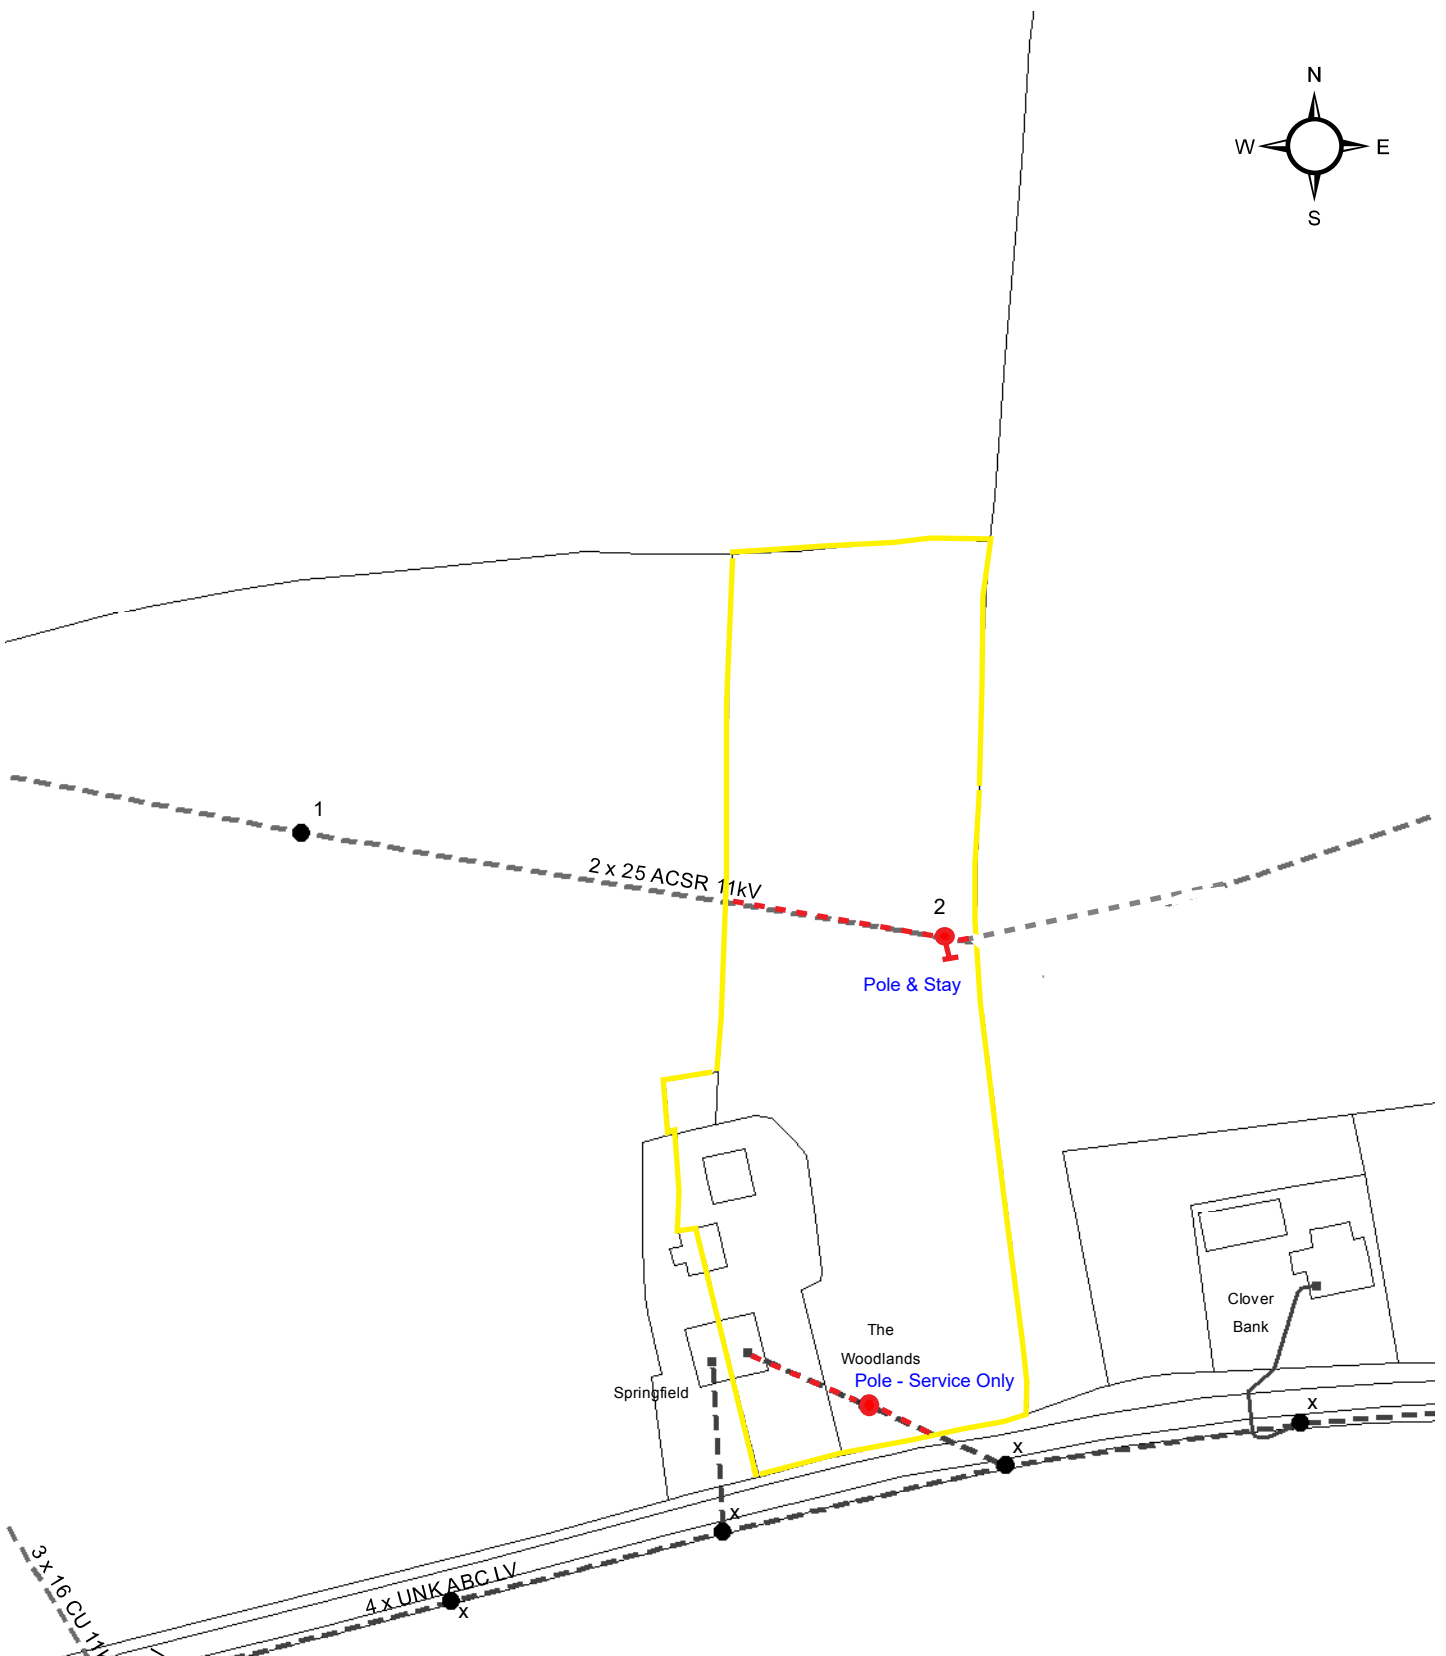


The Woodlands



<p>SP ENERGY NETWORKS On behalf of SP Manweb plc</p>		SAP Agreement No. <input type="text"/>	
<p>This is the plan referred to in the foregoing Wayleave agreement</p>			
<input type="text"/>	<input type="text"/>	<input type="text"/>	SCALE 1 : 1,250
SIGNATURE FOR THE COMPANY	SIGNATURE FOR THE COMPANY	DATE	MAY REFERENCE 338,227 358,982
<input type="text"/>	<input type="text"/>	DATE	
OWNER/OCCUPIER			

Information about apparatus given on this drawing is indicative only as the original depths and lines of cables and pipes may have been changed by persons unknown. Normally electricity cables are laid in trenches between 450mm and 1m deep, but cellars or structures such as bridges may prevent cables and pipes being laid at these standard depths. Also, the depth may be above or below the standard due to regrading of the surface or other work after the cables are laid. Where known, non-standard depths are indicated. Any interference with, or damage to, ScottishPower apparatus may result in serious accident. Health and Safety Executive booklet HS(G) 47 provides information on the avoidance of danger from underground services. Authorities and contractors will be held liable both for the full cost of repairs to ScottishPower apparatus and all claims made against ScottishPower by Third parties as a result of interference or damage. In the event of an emergency or should you require further assistance contact 0800-092-9290 (ScottishPower area) or 0800-001-5400 (SP Manweb area).
 Reproduced from (or based upon) Ordnance Survey maps by Power Systems with the permission of Ordnance Survey on behalf of the controller of HMSO.